


Code Enforcing Agency may require ground connection to be visible when electrical inspection is made. However, for safety reasons, top of ground rod should be flush with or below ground level.

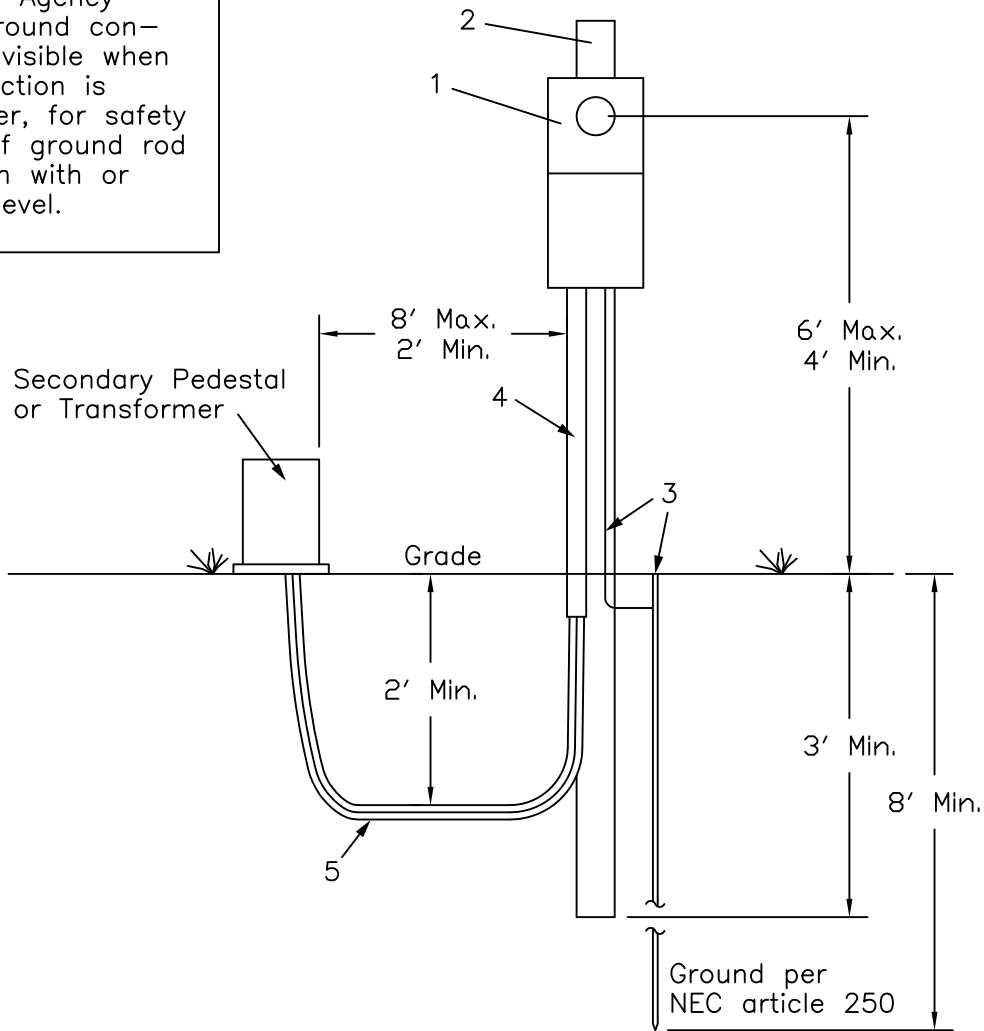

MEMBER REQUIREMENTS:

- 1 NEMA type 3R meter socket and main breaker or disconnect switch. Equipment must be in good condition with no holes or damage (member owned).
- 2 Pressure-treated wood post, minimum size 4"x4" (member owned).
- 3 Grounding per NEC Article 250.
- 4 Conduit sch. 40, rigidly fastened to the post, and must extend at least 6" below grade.
- 5 Service conductor shall be provided by member, and be long enough to connect to CPI's power terminals.
- 6 CPI will terminate service wire on secondary pedestal or transformer.
- 7 Member to provide all trenching and backfill.
- 8 Do not dig within 2 feet of CPI's equipment.

NOTE: All wiring must meet NEC code requirements.

MEMBER EQUIPMENT MUST HAVE PROOF OF STATE ELECTRICAL INSPECTION AND MUST HAVE GREEN TAG ATTACHED BEFORE C.P.I. WILL CONNECT.



CONSUMERS POWER INC.

P.O. Box 1180 Phone 929-3124

Philomath, Oregon 97370-1180

**CPI TEMPORARY METER REQUIREMENTS
UNDERGROUND CONSTRUCTION**

Drawn by: JMC	Date: 1-30-91	Scale: None	Dwg. No. 1262
Chk'd by:	Date: 11-02-17	Revs'd: AGS	Spec. No.